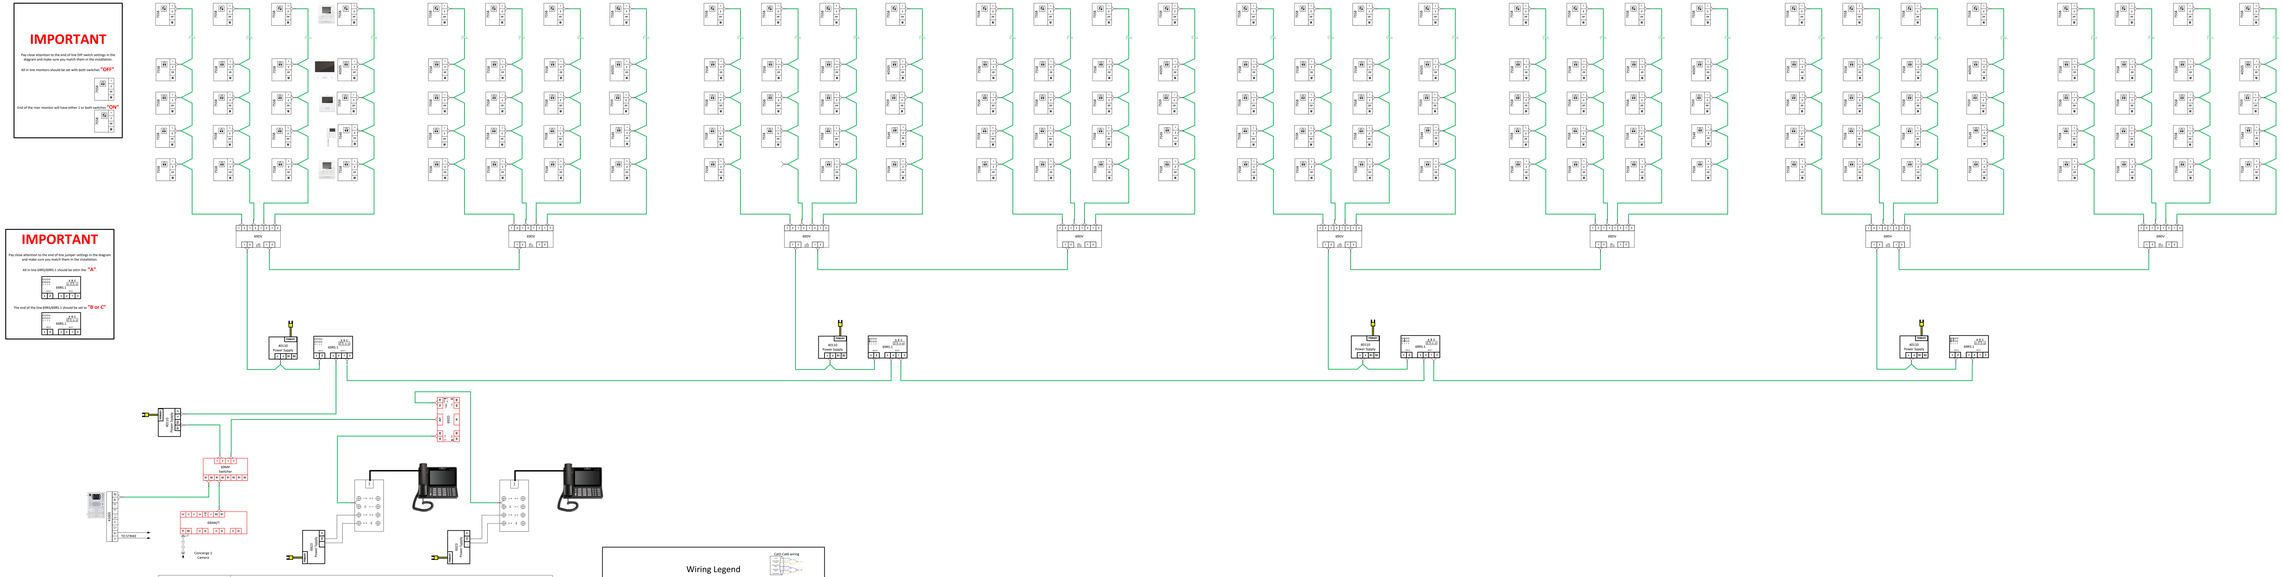
IMPORTANT
Pay close attention to the end of line DIP switch settings in the diagram and make sure you match them in the installation.
All in line monitors should be set with both switches "OFF"
End of the riser monitor will have either 1 or both switches "ON"
IMPORTANT
Pay close attention to the end of line jumper settings in the diagram and make sure you match them in the installation.
All in line EXRS/SXRS-1 should be satin the "A".
The end of the line EXRS/SXRS-1 should be set to "B or C"
EXRS-1
SXRS-1
EXRV
Door Station
Door Station
Door Station